

Technical product and  
installation information

**SANHA**<sup>®</sup>  
a perfect fit



## SANHA Installation Information

Technology · Products · Installation  
All materials

<b>1 General technology .....</b>	<b>4</b>
1.1 Storage and transport .....	4
1.2 External corrosion protection .....	4
1.3 Pipe insulation .....	6
1.4 Seals, sealing agents and sealing aids .....	6
1.5 Mixed installation of carbon steel with stainless steel or copper (alloys) .....	6
1.6 Leak testing .....	7
1.7 Flushing drinking water installations .....	8
1.8 Disinfecting drinking water installations .....	8
1.9 Electrical trace heating .....	9
1.10 Electrical protection measures .....	9
1.11 Internal corrosion in open systems .....	10
1.12 Internal corrosion in closed systems .....	11
1.13 External corrosion .....	12
<b>2 Products .....</b>	<b>14</b>
2.1 Tool compatatibility .....	14
2.2 NiroSan® system fittings and NiroSan® stainless steel system pipes ....	16
2.3 NiroTherm® system fittings and NiroTherm® stainless steel pipes ....	20
2.4 SANHA®-Press   PURAPRESS® system fittings and copper pipes .....	22
2.5 SANHA®-Heavy Steel Press .....	25
2.6 SANHA®-Therm system fittings and carbon steel pipes .....	26
2.7 3fit®-Press and 3fit®-Push: system fittings for multi-layered composite pipes .....	28

2.8	PURAFIT®: Silicon bronze threaded fittings .....	32
2.9	Pressure loss tables for metal and composite pipes .....	34
2.10	Linear thermal expansion of pipes .....	34
2.11	Pipe support spacing .....	36
2.12	Allowable bending radius .....	38
2.13	Space requirements .....	39
<b>3</b>	<b>Pipe joints.....</b>	<b>44</b>
3.1	Recommended press tools .....	44
3.1.1	General requirements .....	44
3.1.2	SANHA press tools .....	46
3.2	Metallic pipe joints .....	47
3.2.1	Preparation of the pressing process.....	48
3.2.2	Pressing d = 12 - 35 mm with pressing jaw .....	49
3.2.3	Pressing d = 1/2 inch - 2 inch with pressing jaw PB2-MP .....	50
3.2.3	Pressing d = 42 - 88,9 mm with pressing loop .....	52
3.2.4	Pressing d = 108 mm with press sling.....	53
3.2.5	Pressing d = 139,7 and 168,3 mm with press sling .....	55
3.2.6	Pressing of d >= 76,1 mm with high pressure press sling .....	56
3.3	Rohrverbindungen mit 3fit®-Press-Systemfittings.....	58
3.3.1	Abmessungen bis 32 mm.....	58
3.3.2	Dimensions of 40 mm, 50 mm and 63 mm.....	60
3.4	Pipe joints using the 3fit®-Push push-fit fittings.....	62

# 1. General technology

The following instructions and information are provided purely as recommendations. The relevant standards, legal requirements and recognised engineering best practice must be observed by the installer at all times. In the event of improper transport, storage, processing or other handling, SANHA cannot accept any liability or warranty assume any liability or warranty.

## 1.1 Storage and transport

Damage, soiling and, for stainless steel materials in particular, contact with iron and unalloyed steel must be prevented during storage and transport to protect against corrosion. For example, we recommend covering the cargo bed with plastic sheeting during transit in HGVs, if iron or unalloyed steel pipes or other components have been previously transported.

## 1.2 External corrosion protection

Due to the corrosion resistance of the SANHA system components (pipes and fittings) external corrosion protection is usually unnecessary, (please note the special instructions for insulating carbon steel). Depending on the surrounding atmosphere and/or the temperature of the medium, external, diffusion resistant insulation may be necessary to prevent external corrosion attack. Special attention must be paid if the atmosphere contains aggressive substances and condensation formation is possible on the pipe surface.



## **Special processing instructions for preventing corrosion when using our SANHA®-Therm carbon steel installation system.**

Our SANHA®-Therm system pipes and fittings are produced from unalloyed E 195 (RSt 34-2) steel with material number 1.0034 compliant with EN 10305-3, with a galvanised coat applied to the outer pipe surface compliant with DIN 50961 and a minimum thickness of 8 µm.

The following processes, which act on the system over an extended period, demand additional protection by the installer:

- moisture in the surrounding atmosphere and/or construction materials
- corrosive substances in the surrounding atmosphere and/or construction materials

In such cases an additional, watertight and non-porous corrosion protection coating compliant with AGI standard Q 151 must be applied. In practice, closed-cell insulating materials or aluminium foil wrapped mineral fibre insulation has proved reliable.

### **Our recommendation:**

If the installation is intended to go beneath a screed or in a humid atmosphere, then Carbon Steel systems can only be used if suitable measures are taken to prevent the action of moisture on the surface.

If prolonged action of moisture cannot be prevented with certainty and/or economic requirements must be adhered to, we recommend using our NiroTherm® stainless steel installation system. This system consists of particularly economical NiroTherm® stainless steel system pipes and system press fittings with material number 1.4301 / 304.

### **1.3 Pipe insulation**

Pipe insulation, in particular the insulation thickness, depends on the respective application. The insulation thickness must be selected by the installer according to the application and relevant standards. The installation instructions of the insulation manufacturer must be followed.

### **1.4 Seals, sealing agents and sealing aids**

Sealing agents and seals, such as flat gaskets, must not release chloride ions into the water or lead to local concentrations of chloride ions. This requirement can be met by using the Centellen flat gaskets used in SANHA components. We recommend using permanently elastic sealants for threaded connections. When using hemp, a chloride-free sealing aid should be used. The use of thread sealing tape such as Teflon/PTFE is not recommended.

### **1.5 Mixed installation of carbon steel with stainless steel or copper (alloys)**

In closed systems that are operated with water that is almost free of oxygen, such as heating systems according to EN 12828 (without approval criteria), solar systems, etc., no permanent, harmful corrosion processes can take place on metal piping materials that can lead to wall perforations: The oxygen present in the heating system during filling with water that meets national requirements is completely degraded by outgassing (oxygen-containing gas accumulation in the radiator or venting of the radiator) and by the (short-term) surface corrosion on the unalloyed steel and the copper materials.

From a corrosion point of view, the piping materials copper (alloys), unalloyed steel and stainless steel can be used for applications in closed heating and cooling water systems or the corresponding systems can be installed together.

### **Practical tip: Pressing copper fittings with stainless and carbon steel tubes**

Due to the different production tolerances of copper and stainless or carbon steel, more force is sometimes required when connecting SANHA®-Press fittings to all SANHA®-Therm, NiroSan® and NiroTherm® pipes. Damage to the sealing ring cannot be ruled out with this combination and the leakproof characteristic cannot be guaranteed. SANHA®-Press fittings made of copper with internal press-fit end must therefore only be pressed with copper pipes according to EN 1057 or GW 392 to ensure a permanently tight connection. SANHA®-Press fittings made of copper with an external press end, on the other hand, can be used with SANHA®-Therm, NiroSan® or NiroTherm® pipes without any problem, without the need for increased force.

## **1.6 Leak testing**

A leak test compliant with EN 1779 should be performed after completion and before commissioning an installation system. Because of the stringent hygiene regulations for drinking water installations and to prevent corrosion, we recommend leak testing using air. Test logs must be produced for leak tests. Relevant test logs for SANHA installation systems can be requested through the SANHA technical hotline at 01628 819245 or be downloaded from our homepage at [www.sanha.co.uk](http://www.sanha.co.uk).

## 1.7 Flushing drinking water installations

All drinking water pipes, regardless of the material used, must always be flushed using filtered drinking water. For hygiene reasons, the drinking water installation must commence its intended operations 72 hours after flushing, at the latest, in order to ensure drinking water quality (hygiene)

- clean the internal pipe surfaces
- avoid any malfunctions in the valves, fittings and water devices

These requirements are met by two flushing methods:

- air-water mixture flushing
- water flushing

## 1.8 Disinfecting drinking water installations

Additional disinfection of the pipe system is not required by EN 806 or national standards and regulations. If in exceptional cases pipe disinfection is necessary or required for specific reasons, then clarification should be sought from our technical department as to their suitability. Appropriate flushing logs can be downloaded from our web site at [www.sanha.co.uk/en/downloads/testing-protocols/](http://www.sanha.co.uk/en/downloads/testing-protocols/)

### Our recommendations

Name	Commercial form	Concentration	Length	Temperature
Hydrogen peroxide H <sub>2</sub> O <sub>2</sub>	Watery solution 5 %, 15 %, 30 %, 35 %, ...	150 mg/l H <sub>2</sub> O <sub>2</sub>	12 hours	max. 25 °C
Sodium hypochlorite NaOCl	Watery solution with max. 15 g/l chlorine	50 mg/l Chlor	12 hours	max. 25 °C
Calcium hypochlorite Ca(OCl) <sub>2</sub>	Granules or tablets with ca. 70 % Ca(OCl) <sub>2</sub>	50 mg/l Chlor	12 hours	max. 25 °C
Chlorine dioxide ClO <sub>2</sub>	Two-components (sodium chloride, sodium persulfite)	6 mg/l ClO <sub>2</sub>	12 hours	max. 25 °C

## **1.9 Electrical trace heating**

Electrical trace heating can be used in SANHA installation systems if the inner pipe wall temperature does not permanently exceed 60 °C. Temperatures short-term in excess of 70 °C are allowed for the purpose of thermal disinfection. To avoid unacceptable pressure build-up when using electrical trace heating, isolated pipe regions with no safety devices installed should not be heated. EN 806 and EN 1711 must be observed at all times.

## **1.10 Electrical protection measures**

All electro-conductive system components must be earthed. Metallic SANHA installation systems (NiroSan®, SANHA®-Press, SANHA®-Therm) form a continuous, conductive pipe joint and must be integrated into the earth circuit. The installer of the electrical system is responsible for the implementation of such electrical protective measures.

## 1.11 Internal corrosion in open systems

**An open system is defined as one which allows air to mix with the circulating water.**

### Stainless Steel

When in contact with oxygen or oxygenated water, a general inert protective Chromium Oxide layer is formed on the surface of the stainless steel. This prevents any subsequent contamination of the water and makes the use of stainless steel safe for all drinking water installations. For this reason the NiroSan® system is ideal for any remedial works required for drinking water installations irrespective of the existing compliant material.

Due to the sensitisation of stainless steel through uncontrolled heating, hot bending of Stainless Steel pipes is not permissible. Care must also be taken if strong oxidation/cleaning agents are used as these may affect the passive protective layer described above. Attention must be paid to manufacturer's guidelines and national standards when using such agents.

### Carbon Steel

Due to the oxidation of mild steel in moist air, the use of Carbon Steel is not recommended for any open systems, unless the internal humidity is controlled.

## 1.12 Internal corrosion in closed systems

In closed systems which are operated with oxygen free water, such as heating and solar systems, no corrosion can take place on metal pipework. For this reason, all material types and combinations are permissible, subject to specific material properties, i.e. temperature resistance. However, it is important that no oxygen penetrates the system.

In hot water systems, where the pH may be higher than normal, acidic corrosion of Zinc may occur leading to the production of Hydrogen and Zinc particles circulating in the water. This will not in itself damage the steel, but may affect the heating system due to the formation of hydrogen pockets, (gas cushion formation). For this reason internally galvanised materials are not recommended in heating installations.



## 1.13 External corrosion

### Underground pipework

All underground pipes and connectors must be protected against mechanical action, by laying in a protective conduit. Metal pipes in addition require protection against external corrosion.

For stainless steel and Copper, anti-corrosive tape and heat-shrinkable sleeves in accordance with DIN 30672, Class A/B, (Corrosive/non corrosive ground), can be used. Pre-protected copper pipes can be used provided they comply with the relevant standard, but the fittings will require separate protection, such as anti-corrosive tape or protective sleeve. Unalloyed steel requires external protection to DIN 30672 Class C. Pipes laid in insulation, beneath floors are to be regarded as being underground for protective purposes.

### Exterior pipework

Generally exterior pipework needs to be protected against mechanical action and the admission of halogens, (F, Cl, Br, I). Stainless Steel does not require any corrosion protection provided the surroundings do not contain chloride content derivatives such as frost protection additives, in which case a suitable coating should be applied.

Copper generally does not require any additional corrosion protection unless gas conduits are involved, in which case the pipe is to be treated as if it were underground.

Carbon Steel if used externally is to be regarded as if it were underground i.e. protected from both mechanical and chemical attacks. For installations within 50m of a salt zone, i.e. a sea front, we recommend Nirosan 316L, wrapped in the appropriate protection to prevent saline deposits corroding the pipework.

### Exposed Internal pipework

Stainless steel does not require any protective measures unless exposed to chloride based additives or when used in a swimming pool environment, in which case a protective coating should be applied. Copper does not require any corrosion protection provided the environment does not contain any ammonium content derivatives, often linked to animal sheds, or meat processing plants, which must be avoided by the use of suitable coatings.

If Carbon Steel is exposed to prolonged moisture or corrosive substances in the atmosphere, in an internal environment, then additional corrosion protection is required.

If you are uncertain about the corrosive nature of the specified environment, please request a detailed environmental analysis from the client and contact the SANHA technical team for advice.

In general, there is no reason why pipework should not be painted. It should be checked that the paint used is fit for purpose and this is usually sought from the paint manufacturer. It is important when applying protective coatings retrospectively, to ensure that a completely uniform application is made to prevent a concentrated corrosive action in exposed areas, particularly in locations such as bracketry and wall penetrations.

## 2. Products

### 2.1 Tool compatatibility

The press tools must be maintained in accordance with the manufacturer's guidelines and the SANHA installation instructions must be adhered to

- The pressing tools up to and including 28 mm must have a minimum pressing force of 18 kN. (kilo-Newtons)
- For general applications and installation instructions please refer to the SANHA Installation manual or request installation training on tel. +44 (0) 1628 819245.
- The pressing tools from 35 mm up to and including 108 mm must have a minimum pressing force of 30 kN.
- For metallic fittings up to and including 54 mm diameter and using jaws and slings for press connections, the original press profile SA, M or V must be used.
- When using the M profile at dimensions 42 - 54 mm only press slings are to be used.
- For metallic fittings above 54 mm, slings used for the press connections must use the original press profile SA or M.
- For original "3fit-press" fittings for your plastic system, the TH profile should be used. For our 3fit-Press Pb-Free/PPSU piping system, press jaws with the original contours TH, B, F H and U can be used.

- The SANHA installation process as outlined in our SANHA Installation manual must be followed.
- When using press tools, all manufacturers' instructions must be used, particularly about the combination of components (jaws/tools) from different
- The combination of different manufactures' press tools may only be used with the express permission of the system designer.
- For special applications such as fire extinguisher systems, the SANHA combipress function does not apply. In these cases, only high-pressure tools may be used.

Please refer to the certificates and technical documents for the respective areas of application of the individual systems and their individual components as well as our installation instructions.

## 2.2 NiroSan® system press fittings and NiroSan® stainless steel system pipes

### NiroSan® system press fittings

The press fittings bodies are produced from molybdenum-stabilised stainless steel pipe, material number 1.4404 /316L, or precision stainless steel casting, material number 1.4408 / 316. The threaded parts are joined to the main body by plasma shielding gas welding and consist of stainless steel, material no. 1.4571. This material generally corresponds to 1.4404 / 316L quality, but contains an additional 0.8 % by weight max. of titanium as an alloy constituent to improve machinability. This guarantees the high NiroSan® product quality standard for these components. NiroSan® system fittings have a thread compliant with EN 10226 and ISO 7/1 (metal to metal sealing joint) with R/Rp pairing. The R stands for a conical (tapered) male thread and Rp for a parallel female thread.

The NiroSan® series 9000 is also available in a special LABS\*- and silicone-free version with EPDM sealing ring and in separate packaging.

\*LABS = Lackbenetzung störende Substanzen

## Brief overview of NiroSan® press-fit stainless steel systems material no. 1.4404 / 316L

Application	Series	Dimension/rated pressure/identification	Seal
<b>NiroSan® *</b> <ul style="list-style-type: none"> <li>· Drinking water</li> <li>· Heating</li> <li>· Rainwater</li> <li>· Fire extinguishing system (wet)</li> <li>· Sprinkler systems (wet)</li> <li>· Inert gases</li> <li>· Cooling water pipes</li> <li>· Ship building</li> <li>· Compressed air (oil ≤ 25 mg/m<sup>3</sup>)</li> </ul>	<b>9000</b>	d = 15 – 22 mm · PN 40 d = 28 – 35 mm · PN 25 d = 42 – 108 mm · PN 16 d = 168,3 mm · PN 16	EPDM colour: black Max. continuous temp.: -30 °C to 120 °C (up to 150 °C short-term) KTW, ACS, ATA and WRAS requirements met
<b>NiroSan® Gas</b> <ul style="list-style-type: none"> <li>· Natural gas, liquid gas (up to PN 5)</li> <li>· Ship building</li> </ul>	<b>17000</b>	d = 15 – 108 mm · PN 5 / GT 5 Erdreichverlegung nicht zulässig	HNBR colour: yellow Max. continuous temp.: -20 °C to 70 °C Requirements compliant with DVGW G 5614 met
<b>NiroSan® Industry*</b> <ul style="list-style-type: none"> <li>· Heating</li> <li>· Rainwater</li> <li>· Compressed air</li> <li>· Fire extinguishing systems</li> <li>· Inert gases</li> <li>· Technical gases</li> <li>· Cooling water pipes</li> <li>· Ship building</li> <li>· Solar systems</li> <li>· District heating supply systems</li> <li>· Low pressure gas systems</li> <li>· Diesel</li> <li>· Fuel oil</li> </ul>	<b>18000</b>	d = 15 – 22 mm · PN 40 d = 28 – 35 mm · PN 25 d = 42 – 108 mm · PN 16	FKM colour: red Max. continuous temp.: -20 °C to 160 °C (depending on medium) Solar thermal up to 160 °C (short-term 280 °C) Resistant against oils and water, glycol mixtures, steam condensate 150 °C max.
<b>NiroSan® SF*</b> <ul style="list-style-type: none"> <li>· Heating</li> <li>· Rainwater</li> <li>· Ship building</li> <li>· Inert gases</li> <li>· Technical gases*</li> <li>· Cooling water pipes</li> <li>· District heating supply systems</li> <li>· Low pressure gas systems</li> <li>· Solar systems (flat plate and vacuum collectors)</li> <li>· Compressed air</li> </ul>	<b>19000</b>	d = 15 – 22 mm · PN 40 d = 28 – 35 mm · PN 25 d = 42 – 108 mm · PN 16	FKM colour: red Max. continuous temp.: -20 °C to 160 °C (depending on medium) Resistant against oils and water, glycol mixtures

### Tools:

d = 15 – 54 mm: Free choice of press machines and jaws or collars · d = 64 – 108 mm: ECO 3/ECO 301/ACO 202XL (see section 3.1)  
 d = 168,3 mm: ACO 401

### Materials:

Formed components: material no. 1.4404 / 316L compliant with EN 10088, precision stainless steel castings: material no. 1.4408 / 316 compliant with EN 10283 Pipes compliant with EN 10088: NiroSan® (bright and solution annealed, internal weld smoothing, upper strength limited) and NiroSan®-ECO, material no. 1.4404 / 316L, NiroSan®-F, material no. 1.4521, NiroTherm®\*: material no. 1.4301 / 304 Pipe dimensions compliant with EN 10312 and DVGW GW 541. Free from harmful constituents compliant with EN 10312, and compliant with the special requirements of DVGW standard GW 541.

\* Max. operating pressure for technical gases (e.g. compressed air, argon, nitrogen, carbon dioxide): 16 bar.

For other gases, please contact our Technical Support for prior approval.

\*\* Not suitable for drinking water

### **NiroSan®, NiroSan®-ECO and NiroSan®-F stainless steel system pipes**

Three different stainless steel pipe systems and four press system fittings for different applications are offered in this product family. The pipe systems are produced from material no. 1.4404 / 316L (NiroSan® and NiroSan®-ECO) or the nickel-free material 1.4521 (NiroSan®-F) and provided in 3 m and 6 m long tubes. The longitudinal welds on the pipes are produced by plasma shielding gas welding, meaning that an absolutely perfect seal, high mechanical strength and the necessary corrosion protection are guaranteed in the weld region. The pipes have a specified maximum strength in order to provide optimal conditions for reliable compression. All stainless steel pipes correspond to material 1.4404 / 316L with a molybdenum content of  $\geq 2.3$  % and a reduced carbon content.

You can choose from the following pipes, depending on the required flow rates or the determined nominal diameters:



### NiroSan® | NiroSan®-F stainless steel system pipes

Nominal diameter DN	Outside diameter mm	Wall thickness mm	Weight of empty system pipe		Water volume l/m
			NiroSan® kg/m	NiroSan®-F kg/m	
12	15	1	0,351	0,339	0,133
15	18	1	0,426	0,411	0,201
20	22	1,2	0,626	0,604	0,302
25	28	1,2	0,806	0,778	0,515
32	35	1,5	1,260	1,216	0,804
40	42	1,5	1,523	1,470	1,195
50	54	1,5	1,974	1,905	2,043
-	64	2	3,109	-	2,827
65	76,1	2	3,715	3,585	4,083
80	88,9	2	4,357	4,204	5,661
100	108	2	5,315	5,128	8,495
125	139,7	2,6	8,936	-	14,208
150	168,3	2,6	10,801	-	20,893

### NiroSan®-ECO stainless steel system pipes

Nominal diameter DN	Outside diameter mm	Wall thickness mm	Weight of empty	Water volume
			NiroSan®-ECO system pipe kg/m	
12	15	0,6	0,217	0,150
15	18	0,7	0,304	0,216
20	22	0,7	0,374	0,333
25	28	0,8	0,546	0,547
32	35	1,0	0,852	0,855
40	42	1,1	1,128	1,244
50	54	1,2	1,588	2,091
65	76,1	1,5	2,805	4,197
80	88,9	1,5	3,287	5,795
100	108	1,5	4,005	8,659

## 2.3 NiroTherm® system fittings and NiroTherm® stainless steel system pipes

The press fitting bodies are produced from stainless steel pipe, material no. 1.4301 / 304. NiroTherm® system fittings have a thread compliant with EN 10226 and ISO 7/1 (metal to metal sealing joint) with R/Rp pairing. The R stands for a conical (tapered) male thread and Rp for a parallel female thread.

NiroTherm® system fittings are especially suitable for installation beneath screed or in other areas where moisture may cause external corrosion in other materials. In contrast to carbon steel, expensive insulation can be dispensed with.

NiroTherm® Industry system fittings are also suitable for use in compressed air, coolant, fuel oil and diesel fuel lines.

**Please note that NiroTherm® may not be used in drinking water installations.**

## Brief overview of NiroTherm® press-fit stainless steel systems, material no. 1.4301 / 304

Application	Series	Dimension/rated pressure/identification	Seal
<b>NiroTherm®*</b> <ul style="list-style-type: none"> <li>· Heating</li> <li>· Cooling water</li> <li>· Technical gases</li> <li>· Compressed air (oil ≤ 25 mg/m<sup>3</sup>)</li> <li>· Rainwater</li> <li>· Inert gases</li> <li>· Cooling water pipes</li> </ul>	<b>91000</b>	d = 15 – 168,3 mm · PN 16 **	EPDM colour: black Max. continuous temp.: -30 °C to 120 °C (up to 150 °C short-term)
<b>NiroTherm® Industry*</b> <ul style="list-style-type: none"> <li>· Compressed air</li> <li>· Technical gases</li> <li>· Cooling water pipes</li> <li>· Fuel oil</li> <li>· Diesel</li> <li>· Solar systems</li> <li>· District heating supply systems</li> <li>· Inert gases</li> <li>· More applications on demand</li> </ul>	<b>98000</b>	d = 15 – 108 mm · PN 16**	FKM colour: red Max. continuous temp.: -20 °C to 160 °C (depending on medium) Solar thermal up to 160 °C (short-term 280 °C) Resistant against oils and water, glycol mixtures

Tools: d = 15 – 54 mm: Free choice of press machines and jaws or collars  
 d = 76,1 – 108 mm: ACO 203 XL (see section 3.1); d = 139,7 – 168,3 mm: ACO 403

### Materials:

Formed components: Material no.: 1.4301 / 304 compliant with EN 10088

Pipes: NiroTherm®\*\*\*: Material no.: 1.4301 / 304 compliant with EN 10088

Pipe dimensions compliant with EN 10312 and DVGW GW 541, bright and solution annealed, upper strength limited

\* Max. operating pressure for technical gases (e.g. compressed air, argon, nitrogen, carbon dioxide): 16 bar

\*\* See separate installation instructions \*\*\* Not suitable for drinking water \*\*\*\* Higher pressures on request

## NiroTherm® stainless steel system pipes

Nominal diameter DN	Outside diameter mm	Wall thickness mm	Weight of empty NiroTherm system pipe kg/m	Water volume l/m
12	15	0,6	0,214	0,150
15	18	0,7	0,301	0,216
20	22	0,7	0,370	0,333
25	28	0,8	0,540	0,547
32	35	1,0	0,844	0,855
40	42	1,1	1,117	1,244
50	54	1,2	1,573	2,091
65	76,1	1,5	2,777	4,197
80	88,9	1,5	3,254	5,795
100	108	1,5	3,965	8,659
125	139,7	2,0	6,835	14,463
150	168,3	2,0	8,255	21,201

## 2.4 SANHA®-Press system fittings and copper pipes

### SANHA®-Press/PURAPRESS® system fittings

All SANHA®-Press system fittings (SANHA®-Press, SANHA®-Press Gas, SANHA®-Press Solar, SANHA®-Press Chrome, SANHA®-Press White) are produced from copper and copper alloys. The copper press fittings are produced – in particular in terms of design, material and surface properties – from Cu-DHP, material no. CW024A, to EN 12449, based on EN 1254-1. The fittings are free of carbon films and drawing agent residues, and fall substantially below the required maximum values. In addition, the properties of the inner surface do not promote microbiological growth. The red bronze (11000 and 13000 series) or lead-free silicon bronze (PURAPRESS® 8000 series) press fittings are used for adapters and, in addition to the press-fit joint, possesses at least one threaded end compliant with EN 10226 and ISO 7/1, type R/Rp). They consist of CuSn5Zn5Pb2- C (CC499K) compliant with EN 1982 or CuZn21Si3P (CW724R-DW). The fittings are free of faults such as shrinkage cavities, pores, cracks, casting and forming residues. The copper and copper alloy fittings are suitable for use in gas distribution systems for hydrogen gas.

PURAPRESS® press fittings consist of a particularly low-corrosion copper alloy (lead-free silicon bronze, CuSi). They are used as adapter fittings for copper and stainless steel pipes and, in addition to the press-fit joint, possesses at least one threaded end corresponding to EN 10226 and ISO 7/1, type R/Rp) or an additional press-fit joint. The press fittings can be combined with copper pipe (conforming to EN 1057 and DVGW GW 392) and the following SANHA stainless steel pipe types:

- NiroSan®-F (1.4521 nickel-free/444)
- NiroSan® ECO (1.4404/316L)
- NiroSan® (1.4404/316L)
- NiroTherm® \*\* (1.4301/304)

## SANHA®-Press copper and red bronze fittings

Application	Series	Dimension/rated pressure/identification	Seal
<b>SANHA®-Press*</b> <ul style="list-style-type: none"> <li>· Drinking water</li> <li>· Heating</li> <li>· Rain water</li> <li>· Compressed air (max oil content <math>\leq 25 \text{ mg/m}^3</math>)</li> <li>· Fire extinguishing (wet)</li> <li>· Ship building</li> <li>· Inert gases*</li> <li>· Cooling</li> </ul>	<b>6000</b> <b>8000</b>	d = 12 – 108 mm · PN 16 Fittings without additional external colour identification	EPDM colour: black Max. continuous temp.: -30 °C to 120 °C (up to 150 °C short-term) KTW, ACS, ATA and WRAS requirements met
<b>SANHA®-Press Gas*</b> <ul style="list-style-type: none"> <li>· Natural gas, liquid gas (up to PN 5)</li> </ul>	<b>10000</b> <b>11000</b>	d = 12 – 108 mm PN 5 / GT-PN 1 Underground installation not permitted	HNBR Colour: yellow Max. continuous temp.: -20 °C to 70 °C Requirements compliant with DVGW G 5614 met
<b>SANHA®-Press Solar*</b> <ul style="list-style-type: none"> <li>· Compressed air</li> <li>· Inert gases</li> <li>· Cooling water pipes</li> <li>· District heating supply systems</li> <li>· Fuel oil</li> <li>· Diesel</li> <li>· Solar systems (flat plate and vacuum collectors)</li> </ul>	<b>12000</b> <b>13000</b>	d = 12 – 108 mm · PN 16	FKM colour: red Max. continuous temp.: -20 °C to 160 °C (depending on medium) Solar thermal up to 160 °C (short-term 280 °C) Resistant against oils and water, glycol mixtures

### Tools:

d = 15 – 54 mm: Free choice of press machines and jaws or collars · d = 64 – 108 mm: ECO 3/ECO 301 (see section 3.1)

### Materials:

Formed components: Material no.: CW024A (Cu-DHP) compliant with EN 1254

Continuous and sand cast parts: Material no.: CC499K (CuSn5Zn5Pb2-C) compliant with EN 1282,

Copper pipe: Material no.: CW024A (Cu-DHP) compliant with EN 1057

Pipes: Pipe dimensions compliant with EN 1057 and DVGW-GW 392 Brief overview of SANHA®-Press copper and red bronze fittings

\* Max. operating pressure for technical gases (e.g. compressed air, argon, nitrogen, carbon dioxide): 16 bar

The fittings are free of faults such as shrinkage cavities, pores, cracks, casting and forming residues, and display no cast porosity as a result of the high material density.

Because they are dezincification resistant and free from stress crack corrosion, PURAPRESS® series fittings represent an optimal solution in terms of corrosion resistance (equivalent to red bronze) and present a premium hygiene solution due to the pure, lead-free alloy.

Typical applications for the PURAPRESS® system are drinking water, central heating, cooling and compressed air.

### Copper installation pipes

All copper pipes corresponding to EN 1057 and DVGW standard GW 392 can be joined assuming the minimum wall thicknesses (see adjacent table) are adhered to:

Copper pipes compliant with EN 1057 in combination with SANHA®-Press/PURAPRESS®										
Outside diameter (mm)	wall thickness (mm)									
	0,6	0,7	0,8	0,9	1,0	1,1	1,2	1,5	2,0	2,5
12	•	•	•		•					
14			•		•					
15		•	•		•					
16					•					
18			•		•					
22				•	•	•	•	•		
28				•	•		•	•		
35					•		•	•		
42					•		•	•		
54								•	•	
64									•	
66,7							•		•	
76,1								•	•	
88,9									•	
108										•

National standards and guidelines relevant to the application must be observed. If other dimensions are needed, please do not hesitate to contact us at [uk@sanha.com](mailto:uk@sanha.com) or call 01628 819245.

## 2.5 SANHA®-Heavy Steel Press

SANHA®-Heavy Steel Press und SANHA®-Heavy Steel Press Gas are galvanised press fittings for thickwalled steel pipes which can be seamless, welded, black, galvanized or epoxy-coated pipes according to EN 10220 / EN 10255.

The fittings comprise of a grip ring and spacer on the fitting (in front of the actual sealing ring) in order to prevent damage when the fitting is pushed onto the pipe.

The connection is additionally strengthened by the grip ring with a 200 % larger surface area of the sealing ring to ensure a permanently tight connection.

Brief overview of SANHA®-Heavy Steel Press and Heavy Steel Press GAs press systems			
Application	Series	Dimension/rated pressure/identification	Seal
<b>SANHA®-HSP</b> <ul style="list-style-type: none"> <li>· Cooling water</li> <li>· Compressed air (dry)</li> <li>· Sprinkler systems (wet)</li> <li>· Technical gases</li> <li>· Low pressure gas systems</li> </ul>	70000	$d \leq 1/2'' - 2'' \cdot PN 16$	EPDM Colour: Black Max. temperature: -30 °C up to 120 °C
<b>SANHA®-HSP Gas</b> <ul style="list-style-type: none"> <li>· Natural gas, liquid gas (up to PN 5)</li> <li>· Compressed air</li> <li>· Fuel oil</li> </ul>	71000	$d \leq 1/2'' - 2'' \cdot PN 16$	HNBR Colour: Yellow Max. temperature: -20 °C up to 80 °C

Tools  
 ACO 203 (1/2 - 2"), ACO 203XL (12"+)

Material:  
 Carbon steel according to EN 10305



## 2.6 SANHA®-Therm system fittings and carbon steel pipes

### SANHA®-Therm system fittings

The press fitting bodies are produced from unalloyed, externally galvanised steel with material no. 1.0034 (E 195). Individual articles are produced from Cu-DHP based on EN 1254-1, material no. CW024A, with external surface finish compliant with EN 12449 or of a copper alloy compliant with EN 1982, with external surface finish. They are sealed using EPDM sealing rings (SANHA®-Therm 24000 series) or FKM sealing rings (SANHA®-Therm Industry 28000 series). SANHA®-Therm system fittings have a thread compliant with EN 10226 and ISO 7/1 (metal to metal sealing joint) with R/Rp pairing, where R stands for a conical (tapered) male thread and Rp for a parallel female thread.

### SANHA®-Therm DZ system pipes

SANHA®-Therm system pipes are produced from unalloyed steel, material no. 1.0034 (E 195) compliant with EN 10305, externally and internally galvanised and provided in 3 m and 6 m lengths. The pipes have a specified maximum strength in order to provide optimal conditions for reliable compression.

You can choose from the following pipes, depending on the required flow rates or the nominal diameters determined in the pipe network analysis:

Please note the instructions discussed in Section 1.2 on corrosion protection in SANHA®-Therm products!

## SANHA®-Therm press system [not for drinking water]

Application	Series	Dimension/rated pressure/identification	Seal
<b>SANHA®-Therm</b> <ul style="list-style-type: none"> <li>· Heating (closed circuits)*</li> <li>· Compressed air (dry, oil content <math>\leq 25 \text{ mg/m}^3</math>)**</li> <li>· Sprinkler systems (wet, see VdS and FM global certificate)</li> <li>· Ship building</li> <li>· Cooling (closed circuits)</li> </ul>	<b>24000</b>	d = 12 – 108 mm PN 16	EPDM colour: black Max. continuous temp.: -30 °C to 120 °C (up to 150 °C short-term)
<b>SANHA®-Therm Industry*</b> <ul style="list-style-type: none"> <li>· Heating (closed circuits, no DZ pipes)*</li> <li>· Compressed air (dry)</li> <li>· Solar systems (no DZ pipes)***</li> <li>· Ship building</li> </ul>	<b>28000</b>	d = 12 – 108 mm PN 16	FKM colour: red Max. continuous temp.: -20 °C to 160 °C (depending on medium) Solar thermal up to 160 °C (short-term 280 °C) Resistant against oils and water, glycol mixtures

### Tools:

d = 15 – 54 mm: Free choice of press machines and jaws or collars · d = 66,7 – 108 mm: ECO 3/ECO 301/ACO 202XL (see section 3.1)

### Materials:

Formed components: Material no.: 1.0034 (E 195) compliant with EN 10305, externally galvanized compliant with DIN 50961, Continuous and sand cast parts: Material no.: CW024A (Cu-DHP) compliant with EN 1254 Surface treated externally and internally  
**SANHA®-Therm installation pipes, galvanized on the outside:** precision steel pipes in unalloyed steel E195 (material no. 1.0034)  
**SANHA®-Therm installation pipes, DZ version, galvanized on the in- and outside:** precision steel pipes from unalloyed steel /continuously galvanized steel (Sendzimir process) according to EN 10346, material E 195 (Z275 MBO), material no. 1.0034 according to EN 10305-3  
**SANHA®-Therm „Contiflo“ installation pipes, galvanized:** Hot-dip galvanized unalloyed steel with optimized wall thickness, material E195, material no. 1.0034 according to EN 10305-3

\* SANHA®-Therm DZ pipes up to 45 °C only \*\* Residual oil content with EPDM sealing ring up to Class 5 max.; no residual oil content restriction with FKM sealing ring and SANHA®-Therm DZ system pipe \*\*\* Only in conjunction with special FKM sealing ring in a closed system

## SANHA®-Therm system pipe

Nominal diameter DN	Outside diameter mm	Wall thickness mm	Weight of empty NiroSan®-ECO system pipe kg/m	Water volume l/m
10	12	1,2	0,320	0,072
12	15	1,2	0,408	0,125
15	18	1,2	0,497	0,191
20	22	1,5	0,758	0,284
25	28	1,5	0,980	0,491
32	35	1,5	1,239	0,804
40	42	1,5	1,498	1,195
50	54	1,5	1,942	2,043
65	76,1	2	3,655	4,083
80	88,9	2	4,286	5,661
100	108	2	5,228	8,495

## 2.7 3fit®-Press and 3fit®-Push: System fittings for multi-layered composite pipes

### 3fit®-Press Pb-free and PPSU system fittings [16 – 63 mm]

The press fitting bodies are produced from lead-free silicon bronze CuSi from the material CuZn21Si3P (CW724R-DW). Internal sealing against the pipe is by means of two EPDM sealing rings. This tried and tested jointing type for flexible pipe systems provides an excellent supplement to metal press joints. The 3fit®-Press Pb-free (25000 series) and PPSU (35000 series) system fittings are marked with SANHA 3fit®- Press on the press sleeve. They are tested and approved by DVGW and other international certifying agencies. The system fittings can be used with all MultiFit®-Flex, MultiFit®-PEX and MultiFit®-PE-RT system pipes for an exhaustive range of applications.

The press fittings can be pressed with press jaws with TH, B, F, H, U original profiles.

3fit®-Press Pb-free fittings (25000 series) are the optimal solution in terms of corrosion resistance, because they are dezincification resistant and free from stress crack corrosion (equivalent to red bronze). They display no cast porosity thanks to the high material density. The pure, lead-free alloy makes these fittings a premium hygiene solution. 3fit®-Press PPSU fittings (35000 series) are especially economical and optimal for project business.

## Brief overview of 3fit®-Press system

Application	Series	Dimension/rated pressure/identification	Seal
<b>3fit®-Press PbFree*</b> <ul style="list-style-type: none"> <li>· Drinking water**</li> <li>· Heating</li> <li>· Rainwater</li> </ul>	<b>25000</b>	d = 16 – 63 mm PN 16 (bei 25 °C) PN 10 (bei 70 °C)	EPDM colour: black Max. continuous temp.: -30 °C to 70 °C (short-term up to 95 °C) KTW requirements met
<b>3fit®-Press PPSU*</b> <ul style="list-style-type: none"> <li>· Drinking water**</li> <li>· Heating</li> <li>· Rainwater</li> </ul>	<b>35000</b>	d = 16 – 32 mm PN 16 (bei 25 °C) PN 10 (bei 70 °C)	EPDM colour: black Max. continuous temp.: -30 °C to 70 °C (short-term up to 95 °C) KTW requirements met

### Tools:

d = 16 – 32 mm: free choice of press tools with TH, B, H, F, U original profile (see section 3.1)

### Materials:

Fittings: Material no.: Material no.: CW 724R-DW (CuZn21Si3P) Pipes: MultiFit®-Flex plastic composite pipe compliant with DIN 16833 – 34 consisting of: inliner material: PE-RT; stabilisation pipe: aluminium layer; outer skin material: PE-RT or -HD Multi-Fit®-PEX plastic composite pipe consisting of PE-Xc inner and outer pipe walls, oxygen barrier layer in between (EVOH); PN 6 (at 70 °C), MultiFit®-PE-RT plastic pipe with oxygen barrier layer (EVOH): PN 6

\* Max. operating pressure for technical gases (e.g. compressed air, argon, nitrogen, carbon dioxide): 10 bar

\*\* Only in conjunction with MultiFit®-Flex system pipe

\*\*\* Residual oil content up to Class 5 max.

## Brief overview of 3fit®-Push system

Application	Dimension/rated pressure/identification	Seal
<b>3fit®-Push*</b> <ul style="list-style-type: none"> <li>· Heating</li> <li>· Rainwater</li> </ul>	d = 16 – 20 mm PN 16 (bei 25 °C) PN 10 (bei 70 °C)	EEDPM, colour: black Max. continuous temp.: -30 °C to 70 °C (short-term up to 95 °C) KTW requirements met

No press tools necessary (push-connection)

### Materials:


Fittings: CC499K (CuSn5Zn5Pb2-C) compliant with EN 1282 and CW724R-DW

Pipes: MultiFit®-Flex plastic composite pipe compliant with DIN 16833 – 34 consisting of PE-RT, aluminium layer and PE-HD MultiFit®-PEX plastic composite pipe consisting of PE-Xc inner and outer pipe walls, oxygen barrier layer in between (EVOH); PN 6 (at 70 °C)

\* Max. operating pressure for technical gases (e.g. compressed air, argon, nitrogen, carbon dioxide): 10 bar


\*\* Only in conjunction with MultiFit®-Flex system pipe

\*\*\* Residual oil content up to Class 5 max.

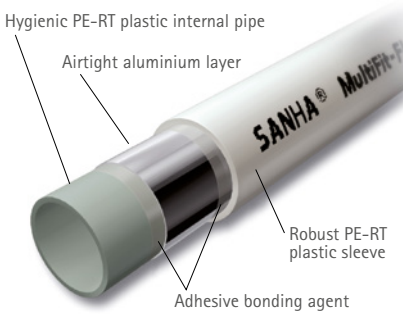


### MultiFit®-Flex system pipes

MultiFit®-Flex system pipes are produced as 5-layer composite pipes with PE-RT plastic inner pipe, laser butt welded aluminium pipe forming an oxygen barrier and PE-HD or PE-RT outside pipe. Thanks to their corrosion safety, MultiFit®-Flex system pipes can be used in all central heating and drinking water installation applications. You can choose from the pipes on page 28.

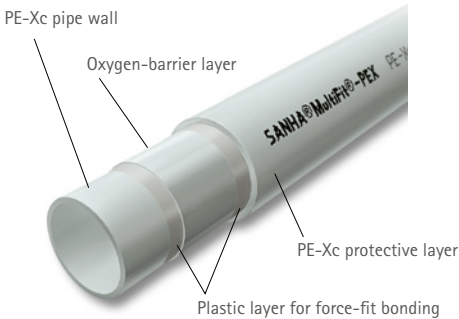

### MultiFit®-PEX system pipes

SANHA also offers the 5-layer plastic composite pipe MultiFit®-PEX, in particular for heating and cooling applications. It consists of radiation cured PE-Xc and a special plastic oxygen barrier (EVOH).

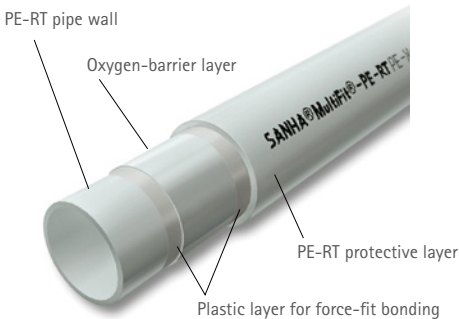

### MultiFit®-PE-RT system pipes

Our MultiFit®-PE-RT pipe system consist of the same material as our Multifit®- Flex pipes except that the 100 % oxygen-tight aluminium layer has been exchanged for an EVOH layer. This makes Multifit®-PE-RT systems the perfect economically sensible alternative for all applications which need no special corrosion protection. SANHA Multifit®-PE-RT pipes are available in 16 x 2 mm and a coil of 400 m.

## MultiFit®-Flex system pipes

d x s mm	S <sub>Al layer</sub> mm	Weight of empty MultiFit®-Flex system pipe kg/m	Weight of water-filled pipe kg/m	Water content l/m	Mounting distance L <sub>1</sub> / L <sub>2</sub> (m)	
					Cold water	Warm water
16 x 2,0	0,20	0,105	0,218	0,113	0,60	0,25
20 x 2,0	0,25	0,140	0,341	0,201	0,70	0,30
26 x 3,0	0,35	0,260	0,574	0,314	0,80	0,35
32 x 3,0	0,50	0,350	0,881	0,531	0,90	0,40
40 x 3,5	0,50	0,500	1,355	0,855	1,10	0,50
50 x 4,0	0,60	0,700	2,085	1,385	1,25	0,60
63 x 4,5	0,80	1,100	3,390	2,290	1,40	0,75

### Further technical data

Coefficient of linear expansion in  $\text{mm} \cdot \text{m}^{-1} \cdot \text{K}^{-1}$  \_\_\_\_\_ 0,023

Thermal conductivity in  $\text{W/m} \cdot \text{K}$  \_\_\_\_\_ » 0,43

Fire classification EN 13501-1 \_\_\_\_\_ D - s2 d0

Fire classification \_\_\_\_\_ B2

Surface roughness in mm \_\_\_\_\_ 0,007

Constant operating temperature \_\_\_\_\_ -20 °C bis 70 °C

Max. acceptable short-time operating temperature \_\_\_\_\_ 95 °C

Max. acceptable short-time operating pressure \_\_\_\_\_ 10 bar

Smallest bending radius without bending tool \_\_\_\_\_ 5 · d

Smallest bending radius with bending tool \_\_\_\_\_ 2 · d

## MultiFit®-PE-RT system pipes

Nominal diameter DN	Outside diameter mm	Wall thickness mm	Weight of empty MultiFit®-Flex system pipe kg/m	Water volume l/m
10	16	2,0	0,091	0,113

## **2.8 PURAFIT®: Silicon bronze threaded fittings**

PURAFIT® threaded fittings (3000 series) are produced from lead-free silicon bronze, material no. CW724R-DW (CuZn21Si3P). The copper alloy used here is suitable for long term use in drinking water installations, because it exceeds the stringent requirements placed on the lead limit value in drinking water: Because if it doesn't contain any lead, it can't release any into the system.

The threaded fittings have a thread compliant with EN 10226 and ISO 7/1 (metal to metal sealing joint) with an R/Rp pairing. The R stands for a conical (tapered) male thread and Rp for a parallel female thread.

An additional sealing agent is employed to compensate for different surface finishes and production tolerances (e.g. hemp as a sealing agent substrate in combination with a sealing agent approved for drinking water and gas installations).

The sealing agent substrate is applied sparingly during installation, so that the tips of the threads remain visible.



**SANHA® threaded fittings operating conditions**  
**PURAFIT® lead-free silicon bronze fittings**

Medium	Dimensions	Operating pressure
Water and aqueous solutions	1/4" ... 3/4"	25 bar up to 120 °C
	1/4" ... 3/4"	16 bar up to 225 °C
	1" ... 3"	16 bar up to 120 °C
	1" ... 3"	6 bar up to 225 °C
Flammable gases (DVGW-G 260)	1/4" ... 3"	5 bar
Technical gases (non-toxic, non-flammable)	1/4" ... 3"	16 bar/depending on application

Thread type: Pipe thread: R/Rp thread compliant with EN 10226,  
 Fixing thread (union nut): G thread (cylindrical) compliant with ISO 228

## 2.9 Pressure loss tables for metal and composite pipes

The appropriate tables for pipe frictional resistance and flow velocities, depending on the flow rate and medium temperature, can be downloaded from our web site, [www.sanha.co.uk](http://www.sanha.co.uk).

## 2.10 Linear thermal expansion of pipes

Pipes expand to different degrees, depending on the material and temperature difference. If the pipes are prevented from expanding their length, the mechanical tensions within the pipe material can exceed the fracture strength, which can result in damage, generally in the form of fatigue failure. To avoid this, the pipe must have sufficient space for expansion.

### Thermal expansion of different pipe materials

Pipe material	Coefficient of thermal expansion $\alpha$ [10 <sup>-6</sup> K <sup>-1</sup> ] (20 °C to 100 °C)	$\Delta l$ [mm] for $l_0 = 10$ m $\Delta T = 50$ K
Stainless steel	16,5	8,3
Copper	16,6	8,3
Galvanised steel pipe	12,0	6,0
Composite pipe	23,0	11,0
MultiFit®-Flex	23,0	11,0
MultiFit®-PEX	200,0	100,0

The flexibility of the pipeline can often be used to compensate for linear expansion. To achieve this, whenever the pipeline changes direction, it is necessary to provide flexible pipe limbs, by arranging the pipe fastenings accordingly.


If the normal pipe routing does not allow sufficient compensation of thermal expansion, this must be achieved by installing special components, e.g. metal axial compensators. If enough space is available, a compensation loop may also be used. Further information can be found in our technical information "Thermal Expansion", which can be downloaded at [www.sanha.co.uk](http://www.sanha.co.uk).

In the case of a concealed or buried installation, unimpeded thermal expansion must be ensured by encapsulating the pipes with elastic, chloride-free material, of sufficient thickness. Ceiling ducts, in particular, must be padded thoroughly, unless a fixed point is installed there deliberately.

The fundamental principle is there must always be sufficient opportunity for expansion between two anchors.

**Thermal expansion of metal pipes [mm]**

Pipe length	Temperature difference (K)								
	Copper			Stainless steel			Galvanised steel		
	30	50	70	30	50	70	30	50	70
1 m	0,50	0,83	1,16	0,50	0,83	1,16	0,36	0,60	0,84
5 m	2,48	4,13	5,72	2,48	4,13	5,72	1,80	3,00	4,20
10 m	4,95	8,25	11,55	4,95	8,25	11,55	3,60	6,00	8,40

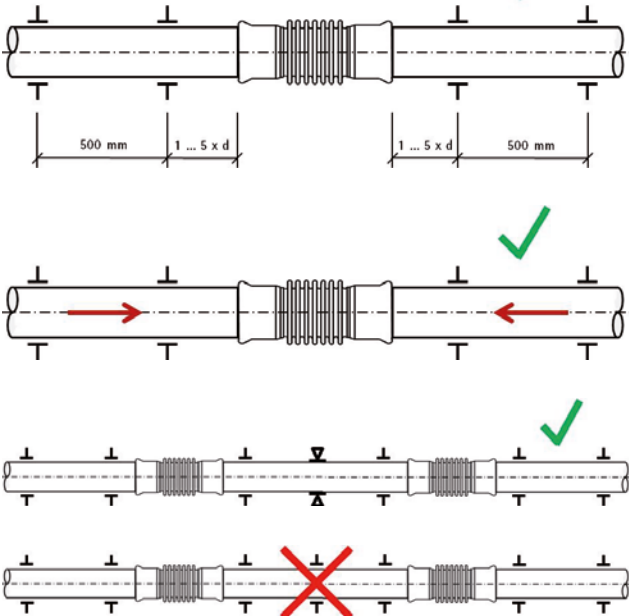

## 2.11 Pipe support spacing


Pipes should be fixed to the building using proprietary pipe brackets, and should not be connected to other pipes. Clamps with rubber inserts should be used to meet noise abatement requirements.

### Maximum spacing for supporting metal pipes

Pipes should be fixed directly to the building using proprietary pipe brackets, as described above, and should not be attached to other pipes. Brackets should only be clamped to the pipe and not to a fitting. A minimum distance between changes in direction must also be observed as this may act as an unintentional fixed point. Similarly, other apparatus or devices may also act as a fixed point, and need to be taken into consideration.


### Maximum spacing for supporting plastic pipes

Outside diameter of pipe mm	Horizontal mm	Vertical mm
16 x 2	1000	1300
20 x 2	1000	1300
26 x 3	1500	1950
32 x 3	2000	2600
40 x 3,5	2000	2600
50 x 4	2500	3250
63 x 4,5	2500	3250

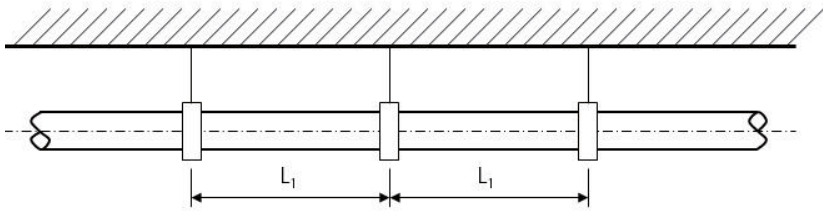

### Maximum spacing for supporting metal pipes

d (mm)		Support spacing (m)	
Copper pipe compliant with EN 1057 / DVGW GW 392	Stainless steel pipe compliant with EN 10312 / DVGW GW 541	for the horizontal pipe string* L1	for the vertical pipe string* L2
12	-	1,00	1,50
15	15	1,20	1,80
18	18	1,20	1,80
22	22	1,80	2,40
28	28	1,80	2,40
35	35	2,40	3,00
42	42	2,40	3,00
54	54	2,70	3,60
64	64	3,00	3,60
66,7	-	3,00	3,60
76,1	76,1	3,00	3,60
88,9	88,9	3,00	3,60
108	108	3,00	3,60
-	139,7	3,00	3,60
-	168,3	3,00	3,60

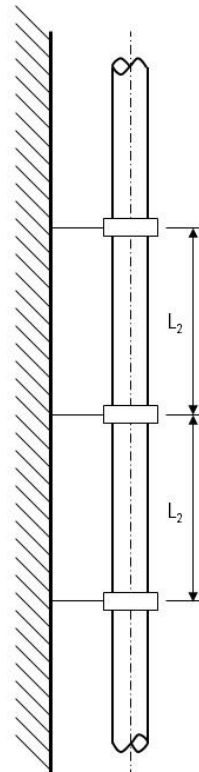

\* The spacing between the supports for copper pipe may vary depending on the locally adopted dimensions as a result of the different wall thicknesses and hardnesses.

## 2.12 Allowable bending radius

Stainless Steel\*, Copper and Carbon Steel can be cold-bent, within limits, using suitable bending tools. For SANHA Stainless steel and Carbon Steel, a bending radius, measured in the bends neutral axis, of at least  $r=3.5*d$  can be achieved, whilst for Copper,  $r=3*d$ . Care should be taken to ensure that following bending, a sufficient piece of cylindrical pipe is available for making further connections. Tighter radii may be achieved but the manufacturer of the bending tool is responsible for the end result. SANHA therm system pipes can be cold-bent up to a dimension of 28 mm.

MultiFit®-Flex, MultiFit®-PEX and MultiFit®-PE-RT plastic composite pipes can be bent by hand, using bending springs and machines. Depending on the bending method used, the minimum bending radius of  $r = 2 \times d$  with bending aid and  $r = 5 \times d$  without bending aid must be adhered to. The pipe on either side of the pressing may not be bent until at least  $1 \times d$  (outside diameter) away from the nearest fitting.

Hot bending of stainless steel and carbon steel pipes is not permissible. Copper pipes must not be bent hot bent in drinking water installations up to and including 28 mm.




### Overview of bending radii for MultiFit®-Flex

Dimension (mm)	W/o bending aid		With bending aid	
16	5 x d	80 mm	2 x d	32 mm
20	5 x d	100 mm	2 x d	40 mm
26	10 x d	260 mm	5 x d	130 mm
32	-	-	5 x d	160 mm
40	-	-	5 x d	200 mm
50	-	-	5 x d	250 mm
63	-	-	5 x d	315 mm

\* only NiroSan® and NiroSan® F


## 2.13 Space requirements

### Installation space SA12-SA35



DN	A	C	A1	B1	C1	A2	C2	D2
12	19	46	24	32	76	24	76	140
14	19	47	24	32	76	24	76	140
15	19	48	24	32	76	24	76	140
16	19	49	24	32	76	24	76	140
18	19	50	24	32	76	24	76	140
22	23	60	29	37	81	29	81	155
28	23	63	29	37	85	29	85	159
35	23	74	31	50	82	31	82	182


## Installation space 42 – 168 and 40 – 63 mm

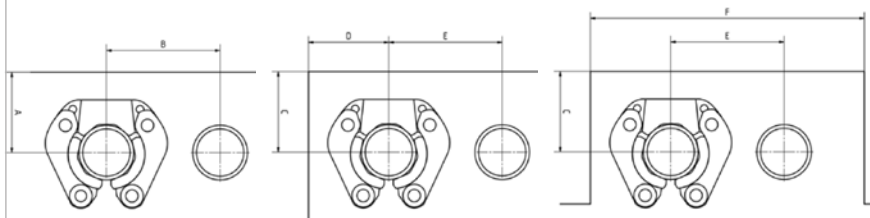

DN	A	B	C	D	E	F
<b>Standard jaws</b>						
42	75	115	75	75	115	265
54	85	120	85	85	120	290
64	81	137	81	98	137	333
66,7	81	139	81	98	139	335
76,1	88	156	88	108	156	372
88,9	94	174	94	119	174	412
108	108	204	108	137	204	478
139,7	140	250	140	170	250	590
168,3	160	285	160	190	285	665
<b>High-pressure slings</b>						
28 HP	55	80	55	60	80	200
35 HP	61	90	61	68	90	226
42 HP	65	102	65	75	102	252
54 HP	68	108	68	76	108	260
76,1 HP	95	165	95	115	165	395
88,9 HP	105	185	105	130	185	445
108,0 HP	115	210	115	145	210	500
<b>SLings for plastic (TH profile)</b>						
TH 40	60	86	60	64	86	214
TH 50	65	99	65	72	99	243
TH 63	72	115	72	82	115	279




The pipe spacing in relation to walls, corners and slots, necessary for a secure installation is laid out in the drawings and tables below.

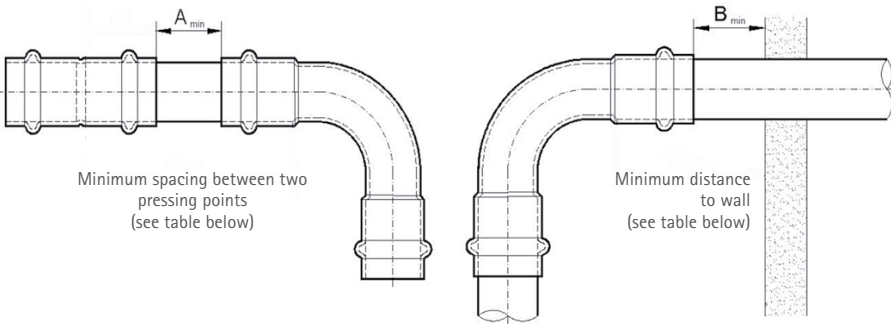

### Minimum distances

Outside pipe diameter mm	Nominal diameter DN	Minimum distance (mm)	
		A <sub>min</sub>	B <sub>min</sub>
12	10	10	60
15	12	10	60
18	15	10	60
22	20	10	60
28	25	10	60
35	32	10	60
42	40	20	60
54	50	20	60
64	50	30	60
66,7	50	30	60
76,1	65	30	60
88,9	80	30	60
108	100	30	60
168,3	150	60	140

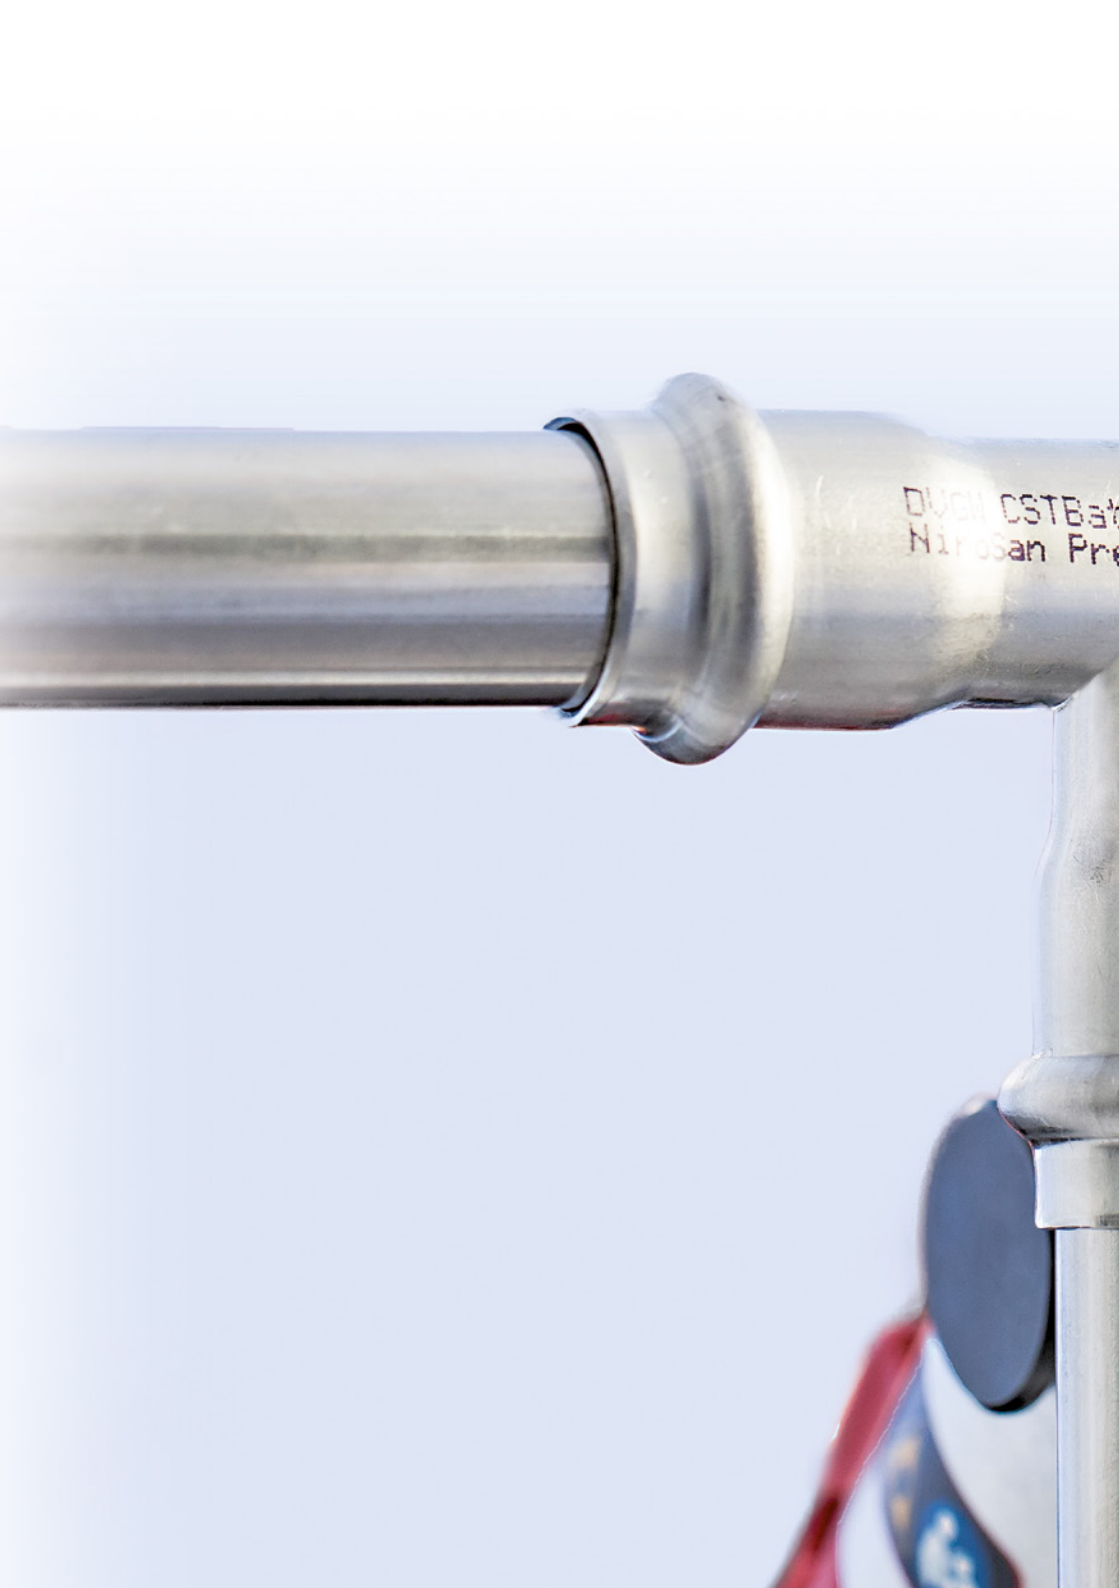A close-up photograph of a metal pipe assembly. The pipe is silver-colored and has a flange-like section. Engraved on the flange are the words "DUCO CSTBat" and "Nippon Pro". The background is a light, clear sky. In the lower right corner, a portion of a red and blue flag is visible.

DUCO CSTBat  
Nippon Pro

Kiwa Uds16<FM>022  
ess 24618

SANHA



# 3. Pipe joints

## 3.1 Recommended press tools

### 3.1.1 General requirements

SANHA is the only manufacturer of press systems who guarantees the tightness of the press connection for standard applications, regardless of the manufacturer of the pressing tools, if the machines and press jaws fulfil the following requirements:

- The press tools must be serviced and maintained in line with the respective manufacturer's guidelines.
- Compact press machines (up to and including 28 mm) must use a minimum press force of 18 kN.
- Conventional and electronic press machines (up to and including 108 mm) must use a minimum press force of 30 kN.
- Elektronic press machines (168.3 mm) must use a minimum press force of 100 kN.
- For metallic pipe joints up to and including 54 mm diameter, the press jaws and collars for M-MM type press joints must have the original SA, M or V profiles.
- For metallic pipe joints greater than 54 mm diameter, the press jaws and collars for M-MM type press joints must have the original SA or M profiles.
- For metallic pipe joints with a diameter of 168.3 mm press slings with an original M profile must be used.
- For 3fit®-Press Pb-free and PPSU system joints the press jaws up to and including 32 mm must have the original TH, B, F, H or U profile. From 40 mm up only the TH profile may be used.

- The SANHA installation instructions for the respective system must be adhered to.
- When using press tools and press machines it is important that the manufacturer's instructions are adhered to, in particular those relating to the combination of tools and machines from different manufacturers.
- The use of press tools in press machines from different manufacturers is only permitted with the express permission of the respective manufacturer.
- Tool compatibility does not apply to special applications, such as fire prevention systems facilities and industrial applications. The appropriate high-pressure press machines and press collars may be used here. Should you require any assistance in this regard, please do not hesitate to contact us at [uk@sanha.com](mailto:uk@sanha.com) or call 01628 819245.

### 3.1.2 SANHA press tools for metal and plastic joints

Every SANHA press machine is provided with a round servicing badge. The markings on this badge indicate when the machine must be sent for its next service to either Novopress or a Novopress authorised workshop. If regularly serviced (annually), the guarantee is increased to three years.

Press machines from other system providers and machine manufacturers must be inspected or serviced according to their instructions at least annually.

The press jaws are subject to high alternating forces. In extreme cases this can lead to material fatigue, but at the very least to substantial wear, in particular on the bolt. To prevent dangerous accidents, SANHA press jaws must be regularly serviced. The press jaws are generally provided with an inspection badge, displaying the date of the next service. If regularly serviced annually the guarantee on SANHA press jaws and press collars increases to up to five years. Conventional and electronically controlled press machines are different.

Conventional press machines adopt an identical press cycle with the same force applied each time. Electronically controlled press machines have a microprocessor within the tool which monitors and controls the force applied and optimises the cycle, depending on material type and dimension of fitting. This significantly prolongs the life of the tool and jaws, and also ensures a more precise press.


### 3.2 Metallic pipe joints

The procedure for producing a press joint is identical for all metal SANHA® press systems. A permanent seal, profile and force-tight connection is described below using the NiroSan® press system as an example. The pipe ends must be clean, free from any scratches, grooves or other damage, for a length equivalent to at least the insertion depth, to produce a perfect press joint.


#### Caution, please note:


- Post-pressing adjustment of pressed components is not allowed.
- Only the press tools listed in the separate installation instructions may be used to produce fixed, water-based fire-fighting systems. Systems available at [www.sanha.com/en/downloads/brochures/](http://www.sanha.com/en/downloads/brochures/). The associated maximum allowable operating pressures can be taken from the VdS certificate.
- Post-pressing insertion depth marking on the pipe is not permitted.
- Only press tools that are regularly serviced in accordance with the respective press tool manufacturers instructions, are mechanically well maintained and in an excellent physical condition should be used.
- Pipelines must be installed tension-free to avoid damages and to maintain the function of the pipeline system. For a correct tension-free installation, our Calculation tables for Thermal expansion must be consulted. They can be downloaded at [www.sanha.com/en/planning-and-installation/downloads/brochures/](http://www.sanha.com/en/planning-and-installation/downloads/brochures/).

### 3.2.1 Preparation of the pressing process [applies to all dimensions]

- 


Pipes should be cut with a roller pipe cutter or cutter or a fine-toothed metal saw suitable fine-toothed metal saw. Tarnish must be avoided at all costs


**IMPORTANT!** When processing stainless steel pipes, the cutting speed must be low enough to prevent sensitisation of the stainless steel by heating. In addition the saw blade or cutting wheel must not have been used for unalloyed ferrous materials before.
- 

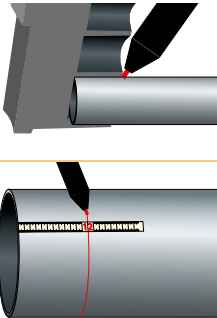Deburr the tube end with a suitable deburring tool (e.g. pipe deburrer or file) inside and outside. Carefully remove chips and deburring residues.
- 

Mark the insertion depth with a waterproof felt-tip pen on the tube or on the outer or on the outer press end of the press fitting.

For dimensions up to 108 mm, insertion depth markers are available (art. no. 84492 (stainless steel) / 84493 (carbon steel and copper)).

For larger dimensions please measure:  
139.7 mm = 98 mm insertion depth  
168.3 mm = 120 mm insertion depth.
- 

Check the sealing ring for correct seating, dirt and damage.
- 


Then insert the pipe end or the outer press end of the press fitting with a slight twisting motion and slightly push the pipe end or the outer press end of the press fitting into the fitting sleeve as far as it will go. The outer edge of the fitting must match the previously applied insertion depth marking.



### 3.2.2 Pressing d = 12 – 35 mm with pressing jaw


Pressing machine ACO 103 [d = up to 28 mm] – ACO 203 and ACO 203 XL [d = up to 35 mm]

1




Select the pressing jaw according to the fitting and ensure clean, smooth surfaces. Insert the pressing jaw into a suitable pressing machine by opening the retaining bolt and closing it completely.

2



Position the pressing tool on the press connection to be made by opening the pressing jaw and placing it at a right angle to the pipe axis, so that the bead of the fitting of the fitting engages in the groove of the pressing jaw. If the outer edge of the fitting match the insertion depth marking?


3




Press and hold the start button for approx. 3 seconds to trigger the pressing process. The process now runs automatically. In case of danger interruption of the pressing process is possible by pressing the emergency stop button. After resetting the the emergency stop situation, a new pressing or, if necessary, a new press process must be started.

### 3.2.3 Pressing $d = 1/2$ inch – 2 inch with pressing jaw PB2-MP


Pressing machine ACO 203 and ACO 203 XL




Select the pressing jaw according to the fitting and ensure clean, slippery contour surfaces. Then insert the pressing jaw by opening the retaining bolt and closing it completely, suitable pressing machine.



Ensure correct seating of sealing element, Make sure that the sealing element, separating ring and cutting ring are correctly seated




Measure the insertion depth and mark it on the pipe. Minimum distance to the weld seams  $3 \times D$  (min. 100 mm)



Push the press connector - without tilting - onto the pipe as far as it will go.


**NOTE!** Pressing on the pipe marking can lead to leaks.

5



Place the pressing jaw around the fitting and make sure that it is correctly seated. Carry out the pressing process until the press ring is completely closed.


6





Remove the control sticker - the press connector is marked as „pressed“. After installation check the correct insertion depth.


### 3.2.3 Pressing d = 42 – 88,9 mm with pressing loop


Pressing machine ACO 203 XL [for d = 42 - 54 mm also ACO 203]

- 

1 Select the sling according to the fitting dimension. Ensure clean, smooth surfaces. From dimension  $d = 64$  onwards, the press slings have a centring plate which must always be positioned in the direction of the pipe section to be pressed in or the outer press end of the fitting.
- 

2 Place the press sling around the press fitting so that the bead of the fitting engages in the groove of the press sling. The press sling must fit tightly against the fitting. The marking lines on the sliding segments and the press sling must form a line. If this is not the case, the sliding segments must be made movable.
- 

3 Select an intermediate jaw to match the dimensions. Then insert the jaw into the suitable pressing machine by opening and completely closing the retaining pin.
- 

4 Turn the pressing sling into the appropriate position the pressing tool. Open the pressing tool by pressing down the jaw levers of the intermediate jaw. Place it on the press sling so that the claws of the intermediate jaw grip around the bolts of the press sling. Check whether the outer edge of the fitting and insertion depth markings match.
- 

5 Press and hold the start button for approx. 3 seconds to start the pressing process. The pressing process now runs automatically. In case of danger, the process can be interrupted by pressing the emergency stop button.


After resetting the emergency stop situation, a repressing or, if necessary, a new pressing must be carried out.

Metal SANHA press fittings from 12 - 54 mm are tool-compatible.

### 3.2.4 Pressing d = 108 mm with press sling


Pressing machine ACO 203 XL

1




Select the sling according to the fitting dimension. Ensure clean, smooth surfaces. From dimension  $d = 64$  onwards, the press slings have a centring plate which must always be positioned in the direction of the pipe section to be pressed in or the outer press end of the fitting.

2




Place the press sling around the press fitting so that the bead of the fitting the bead of the fitting engages in the groove of the press sling. The press sling must fit tightly against the fitting. The marking lines on the sliding segments and the press sling must form a line. If this is not the case, the sliding segments must be made movable.

3




Select intermediate jaw 221 to match dimension 108 mm. Then insert the jaw into the pressing machine ACO 203 XL by opening and completely closing the retaining pin.

4



Turn the pressing sling into the appropriate position the pressing tool. Open the pressing tool by pressing down the jaw levers of the intermediate jaw. Place it on the press sling so that the claws of the intermediate jaw grip around the bolts of the press sling. Check whether the outer edge of the fitting and insertion depth markings match.

5



Press and hold the start button for approx. 3 seconds to start the pressing process. The pressing process now runs automatically. In case of danger, the process can be interrupted by pressing the emergency stop button.

After resetting the emergency stop situation, a repressing or, if necessary, a new pressing must be carried out.

### 3.2.4 Verpressung d = 108 mm with pressing sling

Pressing machine ACO 203 XL

6



Remove intermediate jaw 221 and mount the intermediate jaw 222 (for the complete closure of the press sling).


Then steps 4 and 5 are carried out with the intermediate jaw 222.

The press connection has been made and the press sling can be removed by pulling off the closing flap while activating the locking lever. To do this, slightly press out the pin from the opposite side.


The press sling can only be removed from the press connection if both intermediate jaws have been used.

### 3.2.5 Pressing $d = 139,7$ and $168,3$ mm with press sling


Pressing machine ACO 403




1 Select the sling according to the fitting dimension. Ensure clean, smooth surfaces. The fixation points must always be positioned in the direction of the pipe section to be pressed in or the outer press end of the fitting.




2 Place the press sling around the press fitting so that the bead of the fitting the bead of the fitting engages in the groove of the press sling. The press sling must fit tightly against the fitting. The marking lines on the sliding segments and the press sling must form a line. If this is not the case, the sliding segments must be made movable.



3 Then turn them into position so that the ACO 403 pressing machine can be applied. Check the insertion depth.




4 Start the pressing process. Afterwards, remove the pressing machine by pressing down the jaw levers so that the claws are pulled out of the bolts of the pressing sling.




5 Open the pressing sling and press it staggered on the pressed fitting bead. Fixation points help with orientation. Lock the machine and carry out the 2nd pressing (steps 2 and 4).

### 3.2.6 Pressing of $d \geq 76,1$ mm with high pressure press sling


Pressing machine ACO 403



Select the sling according to the fitting dimension. Ensure clean, smooth surfaces. The fixation points must always be positioned in the direction of the pipe section to be pressed in or the outer press end of the fitting.




Place the press sling around the press fitting so that the bead of the fitting the bead of the fitting engages in the groove of the press sling. The press sling must fit tightly against the fitting. The marking lines on the sliding segments and the press sling must form a line. If this is not the case, the sliding segments must be made movable.

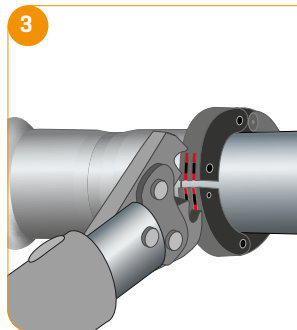

Turn the machine into position to start the press process. Open the pressing tool by pressing down the jaw levers and and place it on the pressing sling so that the claws of the jaw the claws of the jaw grip around the bolts of the pressing sling. Then check whether the outer edge of the fitting and and insertion depth markings match.



4



Place the jaw on the press sling as follows:

Push the claws of the jaw as far as possible into the grooves of the press sling. Close the intermediate jaw by pressing the handle. Check that the marks on the jaw claws are completely covered.

If a marking is partially visible, the jaw must be repositioned. Press and hold the start button to start the pressing process. In case of danger, the pressing process can be interrupted by releasing the start button.<sup>1)</sup>


<sup>1)</sup> After resetting the emergency stop situation, the pressing process must be repeated or, if necessary, re-started.

After pressing has been completed, make sure that there is no gap between the segments of the press sling.


**WARNING!** Risk of injury from flying fragments. Incorrect application of the intermediate jaw to the pressing sling can cause the intermediate jaw and the press sling to break. The claws of the intermediate jaw must grip around the bolts of the press sling.

### 3.3 Rohrverbindungen mit 3fit®-Press-Systemfittings

#### 3.3.1 Abmessungen bis 32 mm



Cut the MultiFit®-Flex, MultiFit®-PEX and Multi-Fit®-PE-RT plastic composite pipe to length perpendicular to the central axis using pipe scissors or a suitable pipe cutter.




Select the deburring and calibration tool suited to the pipe dimension, push it completely into the pipe and carefully rotate clockwise. By doing this, the end of the pipe is calibrated and chamfered simultaneously. Remove any filings from the end of the pipe after completing this step of the procedure.



Check that the end of the pipe is clean and properly deburred (visible by a circumferential 15° chamfer).


**IMPORTANT!** The chamfer must cover the entire circumference as this prevents the O-rings being pushed out of the groove.

4




Push the correct fitting onto the pipe as far as the stop. Check the correct pipe position through the inspection hole in the press sleeve – if visible, the pipe has reached the correct stop position. Check the correct pipe position through the orifice in the press sleeve – the pipe must have reached the fitting stop!

5



Fit the press jaw with the broad groove to the plastic ring on the fitting.

6




Switch on the press machine – the press process is only successfully completed when complete jaw closure is achieved.

### Checking the press connection

The minimum pipe insertion depth can be seen through the inspection hole on the sleeve. Two parallel circular press marks, with a raised ridge in the middle, can be seen around the whole of the press sleeve.

### 3.3.2 Dimensions of 40 mm, 50 mm and 63 mm

Only press collars with TH, F and U profiles may be used for dimensions 40 mm to 63 mm and H profiles for dimension 40 mm. They are initially installed as described in Section 3.3.1 'Dimensions up to 32 mm', steps 1 - 3. Then, for dimensions 40 mm, 50 mm and 63 mm, continue with steps 7 to 11.

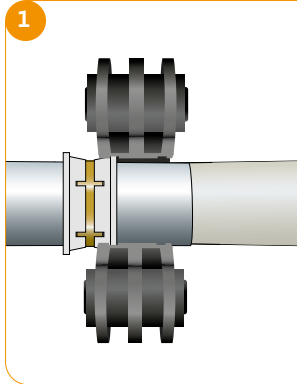


1 Select suitable press collar. Ensure that the marking lines on the sliding segments and the press collar collars form one line. If this is not the case, loosen the sliding segments. Then place the press sling around the press fitting, so that the wide groove encloses the plastic ring. Close the press sling. Push the closing lug into the into the insertion bolt. Make sure that the press sling fits tightly against the fitting. Place press sling into position so that the pressing machine can be properly attached.



2 Select intermediate adapter to suit the dimension. On electronic press machines for dimensions from 40 mm to 63 mm and for conventional press machines, insert intermediate jaw ZB 203 (SANHA catalogue no. 6930) in the press machine and close the retaining bolt.


3



Open the intermediate adapter by pressing the jaw lever down and apply to the press collar such that the intermediate adapter claws engage around the press collar bolts. Press the start button for a minimum of three seconds to initiate the pressing process. This will run automatically and should not be interrupted. This ensures a permanent seal, a smooth profile and a force-tight connection. After completing the pressing process, the pressing tool can be removed from the press collar by opening the intermediate adapter. In case of danger, the pressing process can be halted by pressing the emergency stop button<sup>1</sup>.

<sup>1</sup> After resetting the emergency-stop situation the fitting must be repressed or a new one used.

4




Release the press collar by opening the locking lug. To do this, push out the locking pin from the opposite side.

5




Checking the press joint The minimum pipe insertion depth can be seen through the inspection hole on the sleeve. Two parallel circular press marks, with a raised ridge in the middle, can be seen around the whole of the press sleeve.


### 3.4 Pipe joints using the 3fit®-Push push-fit fittings



Cut the MultiFit®-Flex, MultiFit®-PEX and Multi-Fit®-PE-RT plastic composite pipe to length perpendicular to the central axis using pipe scissors or a suitable pipe cutter.




Select the deburring and calibration tool suited to the pipe dimension, push it completely into the pipe and carefully rotate clockwise. By doing this, the end of the pipe is calibrated and chamfered simultaneously. Remove any filings from the end of the pipe after completing this step of the procedure.



Check that the end of the pipe is clean and properly deburred (visible by a circumferential 15° chamfer).

**IMPORTANT!** The chamfer must cover the entire circumference as this prevents the O-rings being pushed out of the groove.


4



Push the correct fitting onto the pipe axially as far as the stop.

**IMPORTANT!** Push the fitting on axially to ensure the first sealing ring is not pushed out of the groove.


5



Check that the pipe is visible in the push fitting's inspection window.

**IMPORTANT!** The pipe must be inserted as far as the stop. This can be easily inspected in the integrated inspection window.

6



In the pressure test or when pressure is applied the pipe is generally pushed back out of the inspection window slightly. This is design-related; the safe connection between pipe and fitting is guaranteed by the innovative lock function.

responsible  
sustainable  
fair.

## With safety on your side

### SANHA offers genuine advantages



As a family enterprise for over 50 years we have been observing a simple principle: every pipe and every fitting must give the customer added value in terms of safety and practical use at a fair price. This is our mission and, at the same time, the best recommendation from our satisfied customers.

As a specialist for pipeline systems we offer a unique breadth and depth of products for all of the usual connection techniques and applications from a one stop shop. Tried and tested installation techniques are as much a part of our program as practice-oriented innovations.

**And that's why: SANHA. Always a perfect fit.**

#### Your advantages:

**Always a perfect fit** Our customers are central to all our activities. As a family enterprise, SANHA highly values an active close and long term relationship with all our partners, from designers, installers, contractors and trading companies. With over fifty years of service, we are committed to close support of our customers, with a highly experience local and international technical service.

**Large product range** SANHA offers a wide material, product and dimension range, multiple connection methods, with significant expertise and experience – all from a one stop shop. SANHA, the pipeline specialist.

**For what is yet to come** With an active CSR and sustainability strategy, we are w protect the climate and the environment, promote sport and culture and respectful with our employees and partners.

**Nationwide technical service** SANHA is pleased to offer a wide range of services from installation training, technical seminars, design advice, specifications and on site support as and when required.